


RX-Test SSB

Typ: Yaesu FT-847
 Serial-Nr. 3H790071

Frequenz: 145.300.000 MHz

S-Meter Anzeige	Soll -dBm	Messwert -dBm
0	130	116.4
I	127	113.4
II	124	110.5
1 III	121	108.7
IIII	118	107.4
2 IIIII	115	105.9
IIIIII	112	104.5
3 IIIIIII	109	103.0
IIIIIIII	106	101.3
4 IIIIIIIII	103	99.6
IIIIIIIIII	100	98.0
5 IIIIIIIIII	97	96.0
IIIIIIIIIII	94	94.0
6 IIIIIIIIIII	91	91.5
IIIIIIIIIIII	88	89.1
7 IIIIIIIIIIIII	85	86.7
IIIIIIIIIIIII	82	83.9
8 IIIIIIIIIIIIII	79	80.6
IIIIIIIIIIIIII	76	77.0
9 IIIIIIIIIIIIIII	73	73.0

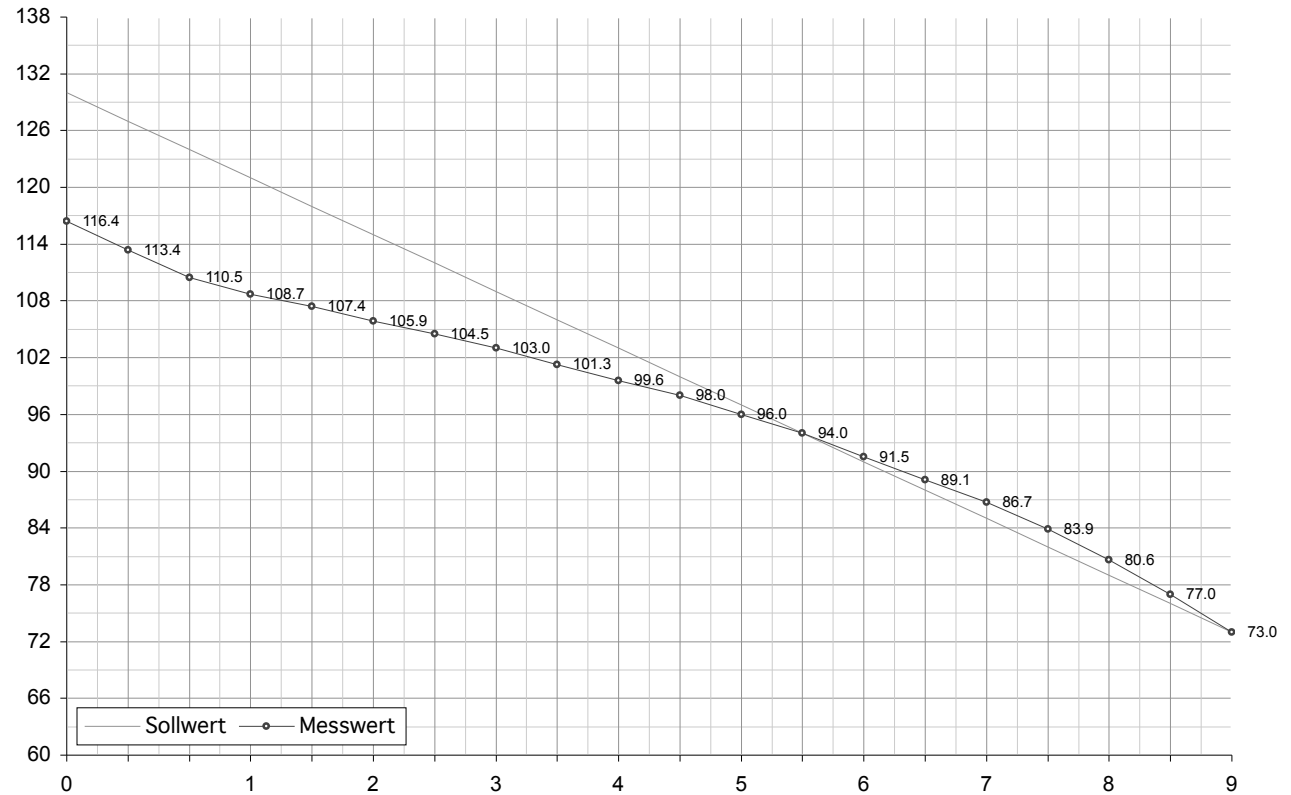

HB9HAL

Messmittel: R&S CMS-B53
 Messdatum: 11. Sept 03